


Instruction manual

dv/dt filter plus Voltage Peak Limiter

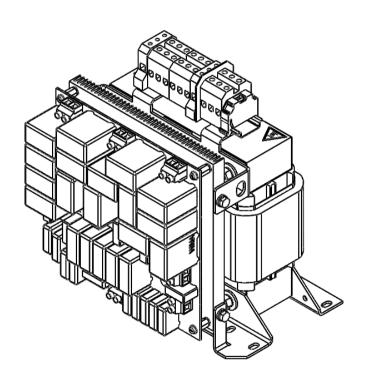

Safety information	1
General	2
Mechanical installation	3
Electrical installation	4
Maintenance and servicing	5
Technical specifications	6

Legal information

Warning notice system

This manual contains notices you have to observe in order to ensure your personal safety, as well as to prevent damage to property. The notices referring to your personal safety are highlighted in the manual by a safety alert symbol, notices referring only to property damage have no safety alert symbol. These notices shown below are graded according to the degree of danger.

DANGER

Indicates that death or severe personal injury will result if proper precautions are not taken

WARNING

Indicates that death or severe personal injury may result if proper precautions are not taken.

/ CAUTION

With a safety alert symbol, indicates that minor personal injury can result if proper precautions are not taken.

CAUTION

Without a safety alert symbol, indicates that property damage can result if proper precautions are not taken.

If more than one degree of danger is present, the warning notice representing the highest degree of danger will be used. A notice warning of injury to persons with a safety alert symbol may also include a warning relating to property damage.

Qualified Personal

The product/system described in this documentation may be operated only by personnel qualified for the specific task in accordance with the relevant documentation for the specific task, in particular its warning notices and safety instructions. Qualified personnel are those who, based on their training and experience, are capable of identifying risks and avoiding potential hazards when working with these products/systems.

Proper use of mdexx products

Note the following:

∕\WARNING

Proper transport, storage, installation, assembly, commissioning, operation and maintenance are required to ensure that the products operate safely and without any problems. The permissible ambient conditions must be adhered to. The information in the relevant documentation must be observed.

Disclaimer of liability

We have reviewed the contents of this publication to ensure consistency with the hardware and software described. Since variance cannot be precluded entirely, we cannot guarantee full consistency. However, the information in this publication is reviewed regularly and any necessary corrections are included in subsequent editions.

Table of contents

1	Sa	afety information	4
	1.1	General safety instructions	4
	1.2	Equipment damage due to electric fields or electrostatic discharge	8
2	G	eneral	9
	2.1	Description	9
	2.2	Assignment of dv/dt filter plus Voltage Peak Limiter and Power Module	11
3	М	lechanical installation	13
	3.1	Mounting position in the enclosure	13
	3.2	Distances to neighboring devices	13
	3.3	Dimensions sheets	14
4	El	lectrical installation	20
	4.1	Overview of electrical connections	20
	4.2	Connection	24
	4.3	Connection overview	24
	4.3	3.1 Cable cross-sections	24
5	М	laintenance and servicing	26
	5.1	Maintenance and servicing not provided	26
6	Te	echnical specifications	27
	6.1	General technical specifications	27
	6.2	Detailed technical specifications	28

1 Safety information

1.1 General safety instructions



/ WARNING

Electric shock and danger to life due to other energy sources

Touching live components can result in death or severe injury.

- Only work on electrical devices when you are qualified for this job.
- Always observe the country-specific safety rules.

Generally, the following six steps apply when establishing safety:

- 1. Prepare for disconnection. Notify all those who will be affected by the procedure.
- 2. Isolate the drive system from the power supply and take measures to prevent it being switched back on again.
 - Wait until the discharge time specified on the warning labels has elapsed.
 - Check that there is no voltage between any of the power connections, and between any of the power connections and the protective conductor connection.
 - Check whether the existing auxiliary supply circuits are de-energized.
 - Ensure that the motors cannot move.
- 3. Identify all other dangerous energy sources, e.g. compressed air, hydraulic systems, or water.
- 4. Isolate or neutralize all dangerous energy sources, e.g. by closing of switches,
- 5. Switch the energy sources to a safe state.
- 6. Check that the correct drive system is completely locked.

After you have completed the work, restore the operational readiness in the inverse sequence.



WARNING

Electric shock due to connection to an unsuitable power supply

When equipment is connected to an unsuitable power supply, exposed components may carry a hazardous voltage that might result in serious injury or death.

• Only use power supplies that provide SELV (Safety Extra Low Voltage) or PELV-(Protective Extra Low Voltage) output voltages for all connections and terminals of the electronics Modulees.



/!\WARNING

Electric shock due to equipment damage

Improper handling may cause damage to equipment. For damaged devices, hazardous voltages can be present at the enclosure or at exposed components; if touched, this can result in death or severe injury.

- Ensure compliance with the limit values specified in the technical data during transport, storage and operation.
- Do not use any damaged devices.



/!\WARNING

Electric shock due to unconnected cable shield

Hazardous touch voltages can occur through capacitive cross-coupling due to unconnected cable shields.

• As a minimum, connect cable shields and the conductors of power cables that are not used (e.g. brake cores) at one end at the grounded housing potential.



/ WARNING

Electric shock if there is no ground connection

For missing or incorrectly implemented protective conductor connection for devices with protection class I, high voltages can be present at open, exposed parts, which when touched, can result in death or severe injury.

Ground the device in compliance with the applicable regulations.



/ WARNING

Arcing when a plug connection is opened during operation

Opening a plug connection when a system is operation can result in arcing that may cause serious injury or death.

• Only open plug connections when the equipment is in a voltage-free state, unless it has been explicitly stated that they can be opened in operation.

NOTICE

Property damage due to loose power connections

Insufficient tightening torques or vibration can result in loose power connections. This can result in damage due to fire, device defects or malfunctions.

- Tighten all power connections to the prescribed torque.
- Check all power connections at regular intervals, particularly after equipment has been transported.

/ WARNING

Spread of fire from built-in devices

In the event of fire outbreak, the enclosures of built-in devices cannot prevent the escape of fire and smoke. This can result in serious personal injury or property damage.

- Install built-in units in a suitable metal cabinet in such a way that Personnel are
 protected against fire and smoke, or take other appropriate measures to protect
 Personnel.
- Ensure that smoke can only escape via controlled and monitored paths.

/ WARNING

Unexpected movement of machines caused by radio devices or mobile phones

When radio devices or mobile phones with a transmission power > 1 W are used in the immediate vicinity of components, they may cause the equipment to malfunction. Malfunctions may impair the functional safety of machines and can therefore put people in danger or lead to property damage.

• If you come closer than around 2 m to such components, switch off any radios or mobile phones.

/ WARNUNG

Damage to motor insulation due to excessive voltages

When operated on systems with grounded line conductor or in the event of a ground fault in a IT system, the motor insulation can be damaged by the higher voltage to ground. If the motor insulation is not designed for operation with grounded line conductors, you have to perform the following measures:

- IT system: Use a ground fault monitor and eliminate the fault as quickly as possible.
- TN or TT systems with grounded line conductor: Use an isolating transformer on the line side.

/ WARNING

Fire due to inadequate ventilation clearances

Inadequate ventilation clearances can cause overheating of components with subsequent fire and smoke. This can cause severe injury or even death. This can also result in increased downtime and reduced service lives for devices/systems.

• Ensure compliance with the specified minimum clearance as ventilation clearance for the respective component.

/ WARNUNG

Unrecognized dangers due to missing or illegible warning labels

Dangers might not be recognized if warning labels are missing or illegible. Unrecognized dangers may cause accidents resulting in serious injury or death.

- Check that the warning labels are complete based on the documentation.
- Attach any missing warning labels to the components, where necessary in the relevant language.
- Replace illegible warning labels.

NOTICE

Device damage caused by incorrect voltage/insulation tests

Incorrect voltage/insulation tests can damage the device.

Before carrying out a voltage/insulation check of the system/machine, disconnect
the devices, since converters and motors have been subject to a high voltage test
by the manufacturer. Therefore it is not necessary to perform an additional test
within the system/machine.

/ WARNING

Unexpected movement of machines caused by inactive safety functions

Inactive or non-adapted safety functions can trigger unexpected machine movements that may result in serious injury or death.

- Observe the information in the appropriate product documentation before commissioning.
- Carry out a safety inspection for functions relevant to safety on the entire system, including all safety-related components.
- Ensure that the safety functions used in your drives and automation tasks are adjusted and activated through appropriate parameterizing.
- Perform a function test.
- Only put your system into live operation once you have guaranteed that the functions relevant to safety are running correctly.

1.2 Equipment damage due to electric fields or electrostatic discharge

Electrostatic sensitive devices are individual components, integrated circuits, modules or devices that may be damaged by either electric fields or electrostatic discharge (ESD)



NOTICE


Equipment damage due to electric fields or electrostatic discharge


Electric fields or electrostatic discharge can cause malfunctions through damaged individual components, integrated circuits, modules or devices.

- Only pack, store, transport and send electronic components, modules or devices in their original packaging or in other suitable materials, e. g. conductive foam rubber of aluminum foil.
- Only touch components, modules and devices when you are grounded by one of the following methods:
 - Wearing an ESD wrist band
 - Wearing ESD shoes or ESD grounding straps in ESD areas with conductive flooring
- Only place electronic components, modules or devices on conductive surfaces (table with ESD surface, conductive ESD foam, ESD packaging, ESD transport container).

The necessary ESD protective measures are clearly illustrated in the following diagram:

- a = conductive floor surface
- b = ESD table
- c = ESD shoes
- d = ESD overall
- e = ESD wristband
- f = cabinet ground connection
- g = contact with conductive flooring








Figure 1-1 ESD protective measures

2 General 2

2.1 Description

General

The dv/dt filter plus Voltage Peak Limiter comprises two components: the dv/dt reactor and the voltage-limiting network (Voltage Peak Limiter), which cuts off the voltage peaks and feeds back the energy into the DC link. The dv/dt filter compact plus Voltage Peak Limiter is designed for use with motors for which the voltage strength of the insulation system is unknown or insufficient.

The dv/dt filter plus Voltage Peak Limiter limits the voltage rise dv/dt to < 500V/µs and the voltage peak on the motor cables to values in accordance with the limit value curve A in compliance with IEC/TS 60034-17.

< 1350 V by 660 V < U_{Line} < 690 V

/!\warning

Danger to life due to non-compliance with the basic safety instructions and residual risks

Failure to observe the Basic Safety Instructions and Residual Risks in Chapter 1 may result in death or serious injury.

- Follow the basic safety instructions.
- · Consider the residual risks in the risk assessment

/!\warning

Risk of fire due to overheating in the case of insufficient ventilation clearances

Insufficient ventilation clearances can lead to overheating with personal injury due to smoke and fire. Furthermore, increased downtime and shortened component life can occur.

- Keep the ventilation clearances of 100 mm above and below the component.
- Mount the dv/dt filters only in a vertical position so that the heat sinks flow through the heat sinks from bottom to top.

NOTICE

Risk of burns due to high surface temperature of the du / dt filter

The dv/dt filters may exceed a surface temperature of over 80 ° C. Touching the surface can cause severe burns.

 Mount the dv/dt filters so that touching is impossible. Where this is not possible, affix a warning in clearly visible and understandable places at places at risk

NOTICE

Damage due to exchanged connections

Interchanging the connections of input (1U1, 1V1, 1W1) and output (1U2, 1V2, 1W2) or DCNS / DCPS will damage the inverter and the voltage peak limiter (VPL).

NOTICE

Damage to the dv/dt filter due to using not released components

Using non-approved components may result in damage or malfunction of equiment or the system

 Use only dv/dt filter which correspond to the electrical data of the frequency inverter.

NOTICE

Damage to the dv/dt filter due to exceeding the maximum output frequency

The maximum allowable output frequency during the operation is 150Hz. Exceeding the maximum output frequency may damage the dv/dt filter.

• Operate the dv/dt filter with a maximum output frequency of 150Hz.

NOTICE

Damage to the dv/dt filter due to exceeding the maximum pulse frequency

The maximum allowable pulse frequency during the operation is 4kHz. Exceeding the pulse frequency may damage the dv/dt filter.

 When using a dv/dt filter, pulse frequency of the Power Module should be not higher than 4kHz

NOTICE

Damage to the dv/dt filter due to missing activation durring the initial setup

A missing activation during the initial setup may cause a damage to the dv/dt filter

 Activate the dv/dt filter during the initial setup via the parameter specified by the inverter manufacturer.

NOTIVE

Damage to the dv/dt filter due to non-connected machine

dv/dt filter that are operates without connect machine can be damaged or destroyed.

Never operate the dv/dt filter with a Power Module without connected motor

Note cable lengths:

Keep the cable length to the Power Module as short as possible (max. 5m).

2.2 Assignment of dv/dt filter plus Voltage Peak Limiter and Power Module

Table 2- 1 Assignment of dv/dt filter plus Voltage Peak Limiter and Power Module

Order N. dv/dt-Filter	TEF1203-0GB	TEF1203-0HB	TEF1203-0JB
Electrical data frequency inverter			
Rated power	18.5 kW	37 kW	55 kW
Rated voltage (phase to phase)	690 V (+10%)	690 V (+10%)	690 V (+10%)
Rated output current (rms)	24 A	44 A	64 A
Maximum output current (rms)	38 A	70 A	104 A
Inductance (Tolerance ± 5%)	1,5 mH	1,2 mH	0,9 mH
Winding resistance (Tolerance ± 5%)	3x 20,9 mΩ	3x 14,6 mΩ	3x 10,24 mΩ
Nominal switching frequency	2 kHz	2 kHz	2 kHz
Maximum switching frequency	4 kHz	4 kHz	4 kHz
Output current maximum switching frequency	14.4 A	26.4 A	38.4 A
Maximum inverter frequency	150 Hz	150 Hz	150 Hz
Voltage drop	17,15 V	17,13 V	17,97 V
Rated DC link voltage	935 V	935 V	935 V
Maximum voltage rise at motor terminals 1)	< 500 V/µs	< 500 V/µs	< 500 V/µs
Maximum peak voltage at motor terminals	1350 V	1350 V	1350 V
(phase to phase) 2)			
Maximum peak voltage at motor terminals	1100 V	1100 V	1100 V
(phase to earth) 2)			
Maximum cable length filter – motor	350 m / 525 m	350 m / 525 m	350 m / 525 m
(screened / unscreened)			
Terminal type	Screw terminals	Screw terminals	Screw terminals
Rated terminal cross section (load circuit)	16 mm²	35 mm²	50 mm²
Rated terminal cross section (DC link	16 mm²	16mm²	16 mm²
feedback) 3)			
Degree of protection 4)	IP00	IP00	IP00
Ambient temperature 5)	-20°C to 40°C	-20°C to 40°C	-20°C to 40°C

¹⁾ Voltage rise according IEC/TS 60034-17

²⁾ Under nominal DC link voltage

³⁾ Short-circuit-proof wiring is required

⁴⁾ Installing the filter in an enclosure is required

⁵⁾ Higher ambient temperatures up to 60°C allowed with current derating at 40°C, in the range 40...50°C with 1,5% per 1K and in the range 50...60°C with 1,9% per 1K

Table 2-2 Assignment of dv/dt filter plus Voltage Peak Limiter and Power Module

Order N. dv/dt-Filter	TEF1203-0KB	TEF1203-0LB	TEF1203-0MB
Electrical data frequency inverter			
Rated power	90 kW	132 kW	250 kW
Rated voltage (phase to phase)	690 V (+10%)	690 V (+10%)	690 V (+10%)
Rated output current (rms)	103 A	146 A	260 A
Maximum output current (rms)	160 A	230 A	416 A
Inductance (Tolerance ± 5%)	0,53 mH	0,37 mH	0,22 mH
Winding resistance (Tolerance ± 5%)	3x 4,9 mΩ	3x 3,25 mΩ	3x 1,4 mΩ
Nominal switching frequency	2 kHz	2 kHz	2 kHz
Maximum switching frequency	4 kHz	4 kHz	4 kHz
Output current maximum switching frequency	61.8 A	87.6 A	156 A
Maximum inverter frequency	150 Hz	150 Hz	150 Hz
Voltage drop	17,2 V	17,1 V	18,0 V
Rated DC link voltage	935 V	935 V	935 V
Maximum voltage rise at motor terminals 1)	< 500 V/µs	< 500 V/µs	< 500 V/µs
Maximum peak voltage at motor terminals	1350 V 1500 V	1350 V 1500 V	1350 V 1500 V
(phase to phase) 2) 6)			
Maximum peak voltage at motor terminals	1100V	1100V	1100V
(phase to earth) 2)			
Maximum cable length filter – motor	450 m / 650 m	450 m / 650 m	450 m / 650 m
(screened / unscreened) 6)	525 m / 800 m	525 m / 800 m	525 m / 800 m
Terminal type	Bus bar M8	Bus bar M10	Bus bar M10
Rated terminal cross section (load circuit)	95 mm²	120 mm²	2x120 mm²
			1x185 mm²
Rated terminal cross section (DC link	25 mm²	25 mm²	50 mm²
feedback) 3)			
Degree of protection 4)	IP00	IP00	IP00
Ambient temperature 5)	-20°C to 40°C	-20°C to 40°C	-20°C to 40°C

¹⁾ Voltage rise according IEC/TS 60034-17

²⁾ Under nominal DC link voltage

³⁾ Short-circuit-proof wiring is required

⁴⁾ Installing the filter in an enclosure is required

⁵⁾ Higher ambient temperatures up to 60°C allowed with current derating at 40°C, in the range 40...50°C with 1,5% per 1K and in the range 50...60°C with 1,9% per 1K


⁶⁾ Maximum peak voltage at motor terminals < 1350V at cable length up to 450m screened or 650m unscreened Maximum peak voltage at motor terminals < 1500V at cable length up to 525m screened or 800m unscreened

3 Mechanical installation

Mechanical installation


3

3.1 Mounting position in the enclosure

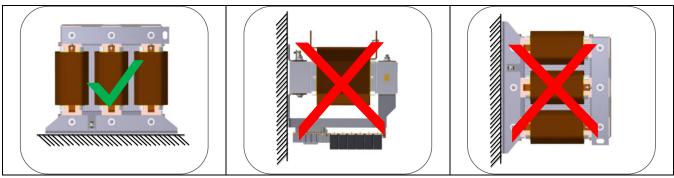

Picture 3-1 Mounting position in the enclosure


3.2 Distances to neighboring devices

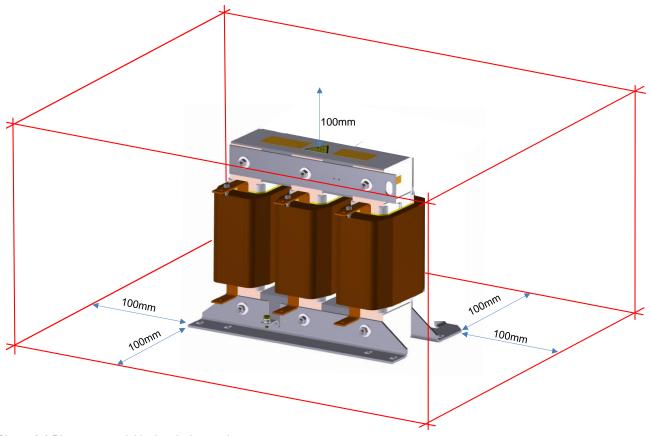

Picture 3-2 Distances to neighboring devices and components


3.3 Dimensions sheets


dv/dt filter TEF1203-0GB

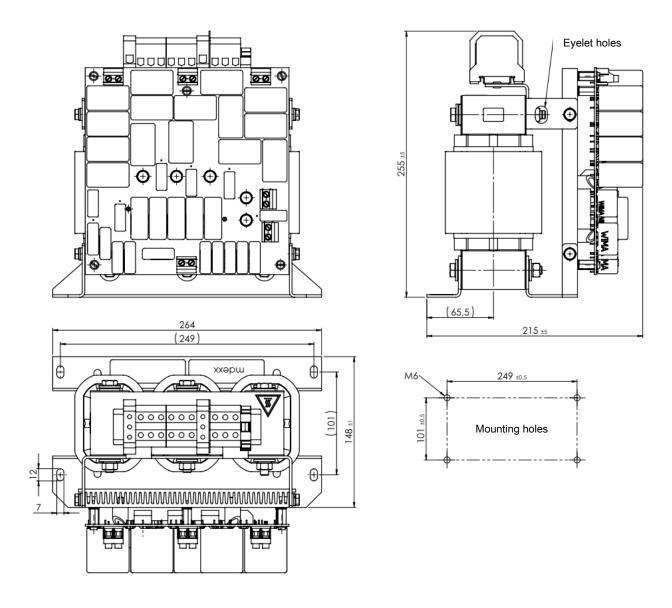



Picture 3-1 Technical drawing dv/dt filter MTZEF051-21

dv/dt filter TEF1203-0HB



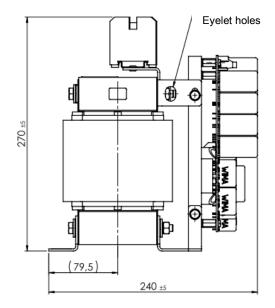


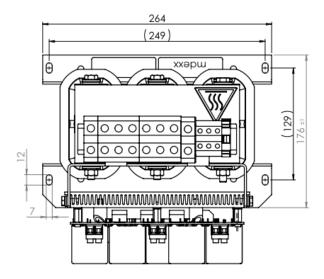




Picture 3-2 Technical drawing dv/dt filter MTZEF051-22

dv/dt filter TEF1203-0JB

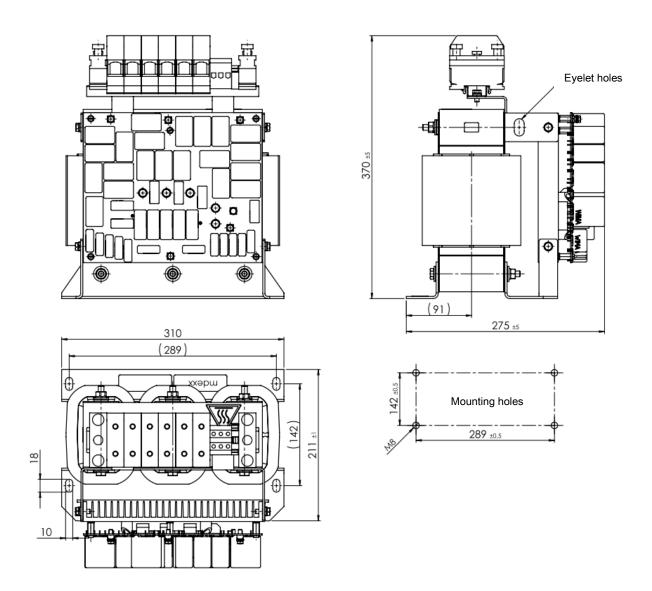


Picture 3-3 Technical drawing dv/dt filter MTZEF051-23

dv/dt filter TEF1203-0KB

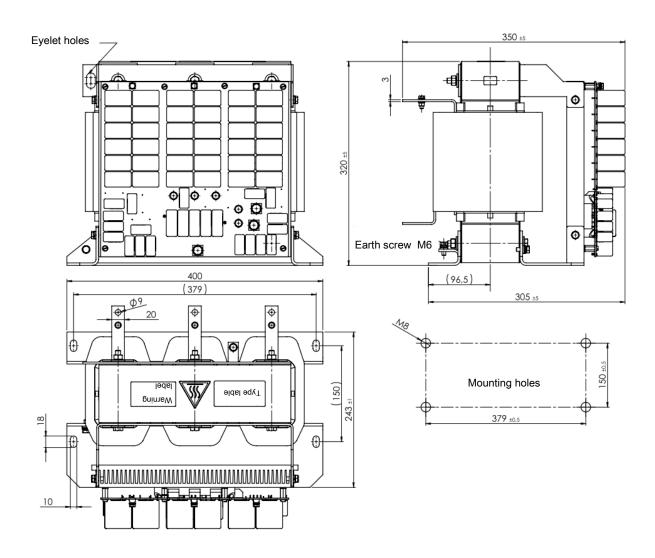


Picture 3-4 Technical drawing dv/dt filter MTZEF051-24

dv/dt filter TEF1203-0LB

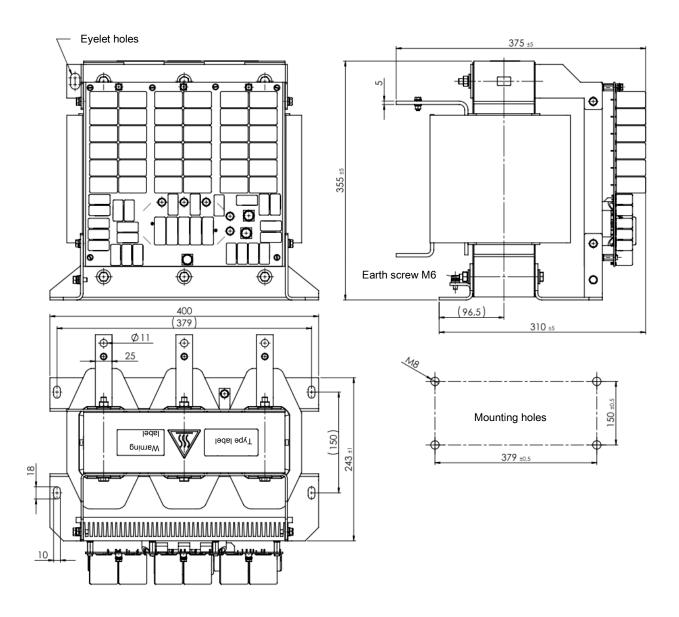

Picture 3-5 Technical drawing dv/dt filter MTZEF051-25

dv/dt filter TEF1203-0MB

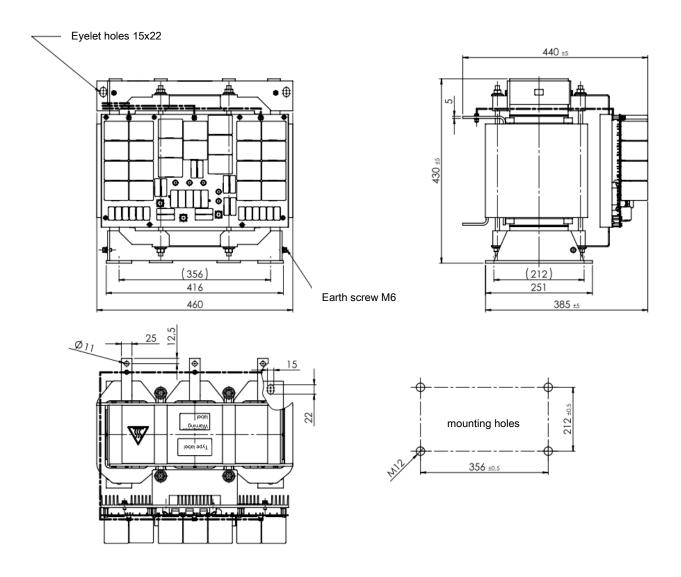


Picture 3-6 Technical drawing dv/dt filter MTZEF051-26

4

4 Electrical installation

4.1 Overview of electrical connections

dv/dt filter TEF1203-0GB

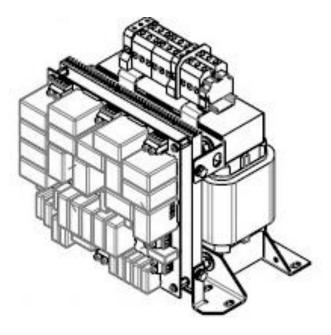


Overview electrical connections

exemplary for:

TEF1203-0GB


TEF1203-0HB

TEF1203-0JB

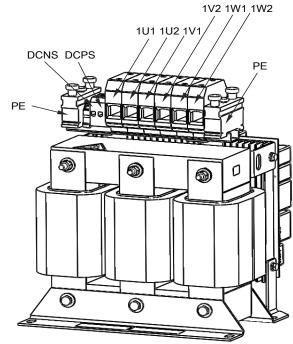


Picture 4-1 Electrical connections dv/dt filter TEF1203-0GB

dv/dt filter TEF1203-0HB

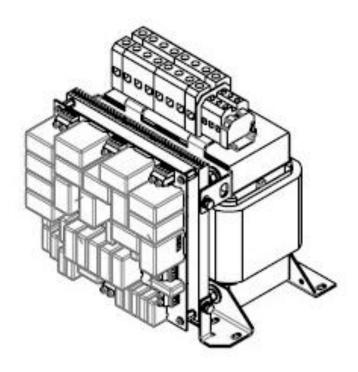


Picture 4-2 Electrical connections dv/dt filter TEF1203-0HB


dv/dt filter TEF1203-0JB

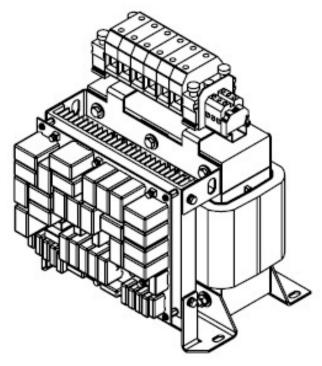

Picture 4-3 Electrical connections dv/dt filter TEF1203-0JB

dv/dt filter TEF1203-0KB

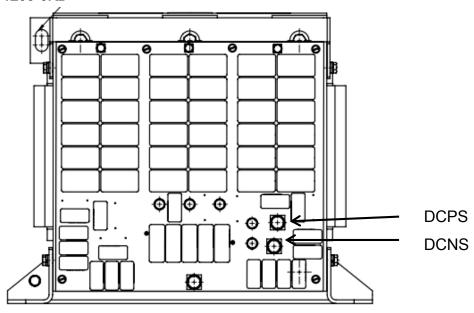

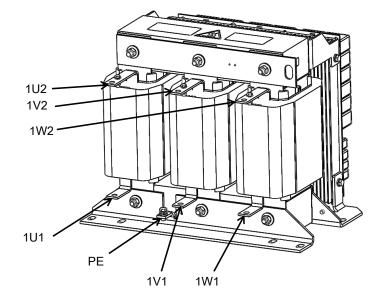

Overview electrical connections

exemplary for:


TEF1203-0KB

TEF1203-0LB


TEF1203-0MB

Picture 4-4 Electrical connections dv/dt filter TEF1203-0KB

dv/dt filter TEF1203-0LB

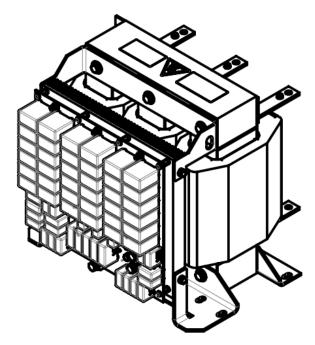


Customer connection protective earth

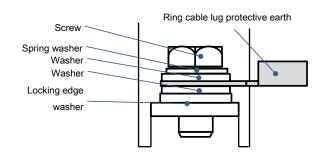


Picture 4-5 Electrical connections dv/dt filter TEF1203-0LB

dv/dt filter TEF1203-0MB

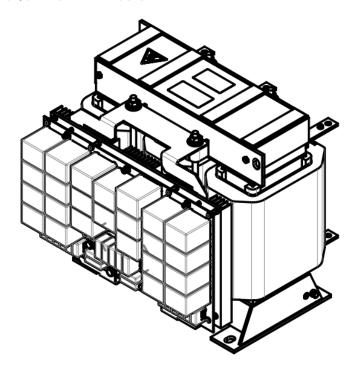

Customer connection protective earth




Picture 4-6 Electrical connections dv/dt filter TEF1203-0MB

4.2 Connection

To ensure a correct function, the following conditions must be considered:

- Control cables must be routed separately from power cables. Power cables are motor cables
 or the connecting cables from the DC link of the Power Module (+ / connection directly
 before the AC inverter) to the dv/dt filter. In particular, you must ensure that control cables and
 power cables are not routed in parallel in a joint cable raceway, even if all cables are shielded.
- The ground wire for the motor must fed directly back to the Power Module

4.3 Connection overview

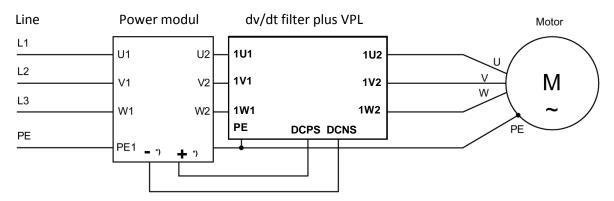

^{*)} Connection to the DC link directly in front of the AC inverter as a short-circuit-proof wire design

Picture 4-7 Connection overview

4.3.1 Cable cross-sections

In a dv/dt filter with VPL, the connection between dv/dt reactor and Voltage Peak Limiter are already installed.



Fire hazard due to short circuit / ground fault

Insufficient installation of cables to the DC link of the Power Module may cause a short circuit / ground fault with personal injury or fire and smoke

- Use local installation instructions for fault exclusion
- Protect the cables from mechanical damage
- Take one of the following activities:
- Using cables with double insulation.
- Maintaining adequate clearance, using spacers, for example.
- Routing the cables in separate cable ducts or tubes.

/ WARNING

Damage to the dv/dt filter due to mechanical stress on the connections

The connections on the dv/dt filter have not been designed for direct mechanical connection of the motor cables.

• You must take steps to ensure that the mechanical load exerted by the connected cables does not deform these connections.

NOTICE

Damage due to exchanged connections

Interchanging the connections of input (1U1, 1V1, 1W1) and output (1U2, 1V2, 1W2) or DCNS / DCPS will damage the inverter and the voltage peak limiter (VPL).

Note

The connections should be kept as short as possible.

The maximum cable length between the Power Module and the dv/dt filter (motor cable and cables to the DC link) is 5m.

5

5 Maintenance and servicing

5.1 Maintenance and servicing not provided

Maintenance and servicing are not provided for the complete units (dv/dt filter plus VPL) and subcomponents (dv/dt reactor, VPL). In the case of error, full replacement is necessary.

6 Technical specifications

6.1 General technical specifications

Table 6- 1 General technical specifications

Output frequency	0 150 Hz					
Product standard	EN 61558-2-20	EN 61558-2-20				
Rated voltage 2)	690 V+10%					
Insulation class	H (180°C)					
Degree of protection	IP00					
Operating mode	S1					
Approvals	c ₹X us C € EAC					
Ambient conditions	Storage	Transport	Operation			
Ambient temperature	-40 +70 °C	-40 +70 °C	-20 +40 °C			
Relative humidity ¹⁾ (non-condensing) corresponds to	10 100 %	95 % bei 40 °C	5 95 %			
class:	1K4 to EN 60721-3-1	2K4 to EN 60721-3-2	3K3 to EN 60721-3-3			
Mechanical stability	Storage	Transport	Operation			
Vibrational load ¹⁾ - Displacement - Acceleration (x,y,z-axis)	In transport packaging stored EN 60721-3-1	1,5 mm at 5 9 Hz 10 m/s² bei >10 200 Hz 1 oct / min (10x sweep) EN 60721-3-2	0,075 mm at 10 58 Hz 10 m/s ² at >58 200 Hz 1 oct / min (10x sweep) EN 60721-3-3			
according to class / standard	2.1.0072.01	EIN 00/21-3-2	IEC 61800-4-2			
Shock load ¹⁾ - Acceleration (x,y,z-axis) accorring to class / standard	-	-	50 m/s² at 30 ms EN 60721-3-3			

¹⁾ The listed EN standards are the European versions of the international IEC standards with the same designation

²⁾ Maximum allowable line voltage according to UL: 600V

6.2 Detailed technical specifications

Tabelle 6-2 detailed technical specification dv/dt filter plus Voltage Peak Limiter, Part 1

Order Number		TEF1203-0GB	TEF1203-0HB	TEF1203-0JB
Rated current	Α	24	44	64
Total copper losses @150Hz; 690V	W	63	137	221
Total core losses @150Hz; 690V	W	62	166	183
Connection			Metrical (mm² / Nm) Imperial (AWG / lbf in	
			Stripping length (mm))
Line / motor cable		16 / 1,2	35 / 2,5	70 / 6,0
		6 / 11,0	2 / 22	2/0 / 53
		13	17	24
DC link		16 / 1,2	16 / 1,2	16 / 1,2
		6 / 11,0	6 / 11	6 / 11
		13	13	13
Ground		16 / 1,2	35 / 2,5	70 / 10,0
		6 / 11,0	2 / 22	2/0 / 86
		13	17	24

Maximum allowable cable length between dv/dt	m	350 (screened)
filter and motor		525 (unscreened)

Dimensions:				
Width	mm	264	264	310
Heigh	mm	255 ±5	270 ±5	370 ±5
Depth	mm	215 ±5	240 ±5	275 ±5
Weight, app.	kg	20	29	46

Tabelle 6-3 detailed technical specification dv/dt filter plus Voltage Peak Limiter, Part 2

Order Number		TEF1203-0KB	TEF1203-0LB	TEF1203-0MB
Rated current	А	103	146	260
Total copper losses @150Hz; 690V	W	277	383	572
Total core losses @150Hz; 690V	W	138	137	285
Connection			Metrisch (mm² / Nm)	
			Imperial (AWG / lbf in)	
Line / motor cable		95 / 13,0	120 / 13,0	2 x 120 / 13,0
		3/0 / 115	4/0 / 115	2 x 4/0 / 115
				185 / 13,0
				6/0 / 13,0
DC link		25 / 9,0	25 / 9,0	50 / 9,0
		4 / 80	4 / 80	1 / 80
Ground		50 / 6,0	70 / 6,0	95 / 6,0
		1 / 53	2/0 / 53	3/0 / 53

Maximum allowable cable length between dv/dt filter	m	450 (screened) / 525 (screened)
and motor 1)		650 (unscreened) / 800 (unscreened)

Dimensions:				
Width	mm	400	400	460
Heigh	mm	320 ±5	355 ±5	430 ±5
Depth	mm	350 ±5	375 ±5	440 ±5
Weight, app.	kg	77	97	172

Maximum peak voltage at motor terminals < 1350V at cable length up to 450m screened or 650m unscreened
 Maximum peak voltage at motor terminals < 1500V at cable length up to 525m screened or 800m unscreened

Technical Assistance: Telephone: +49 (0) 421 5125 0 Fax: +49 (0) 421 5125 333

Technical Support: E-mail: Anfrage@mdexx.com

Internet: http://www.mdexx.com/support/

Subject to change without prior notice. Store for use at a later date.